






Heating System

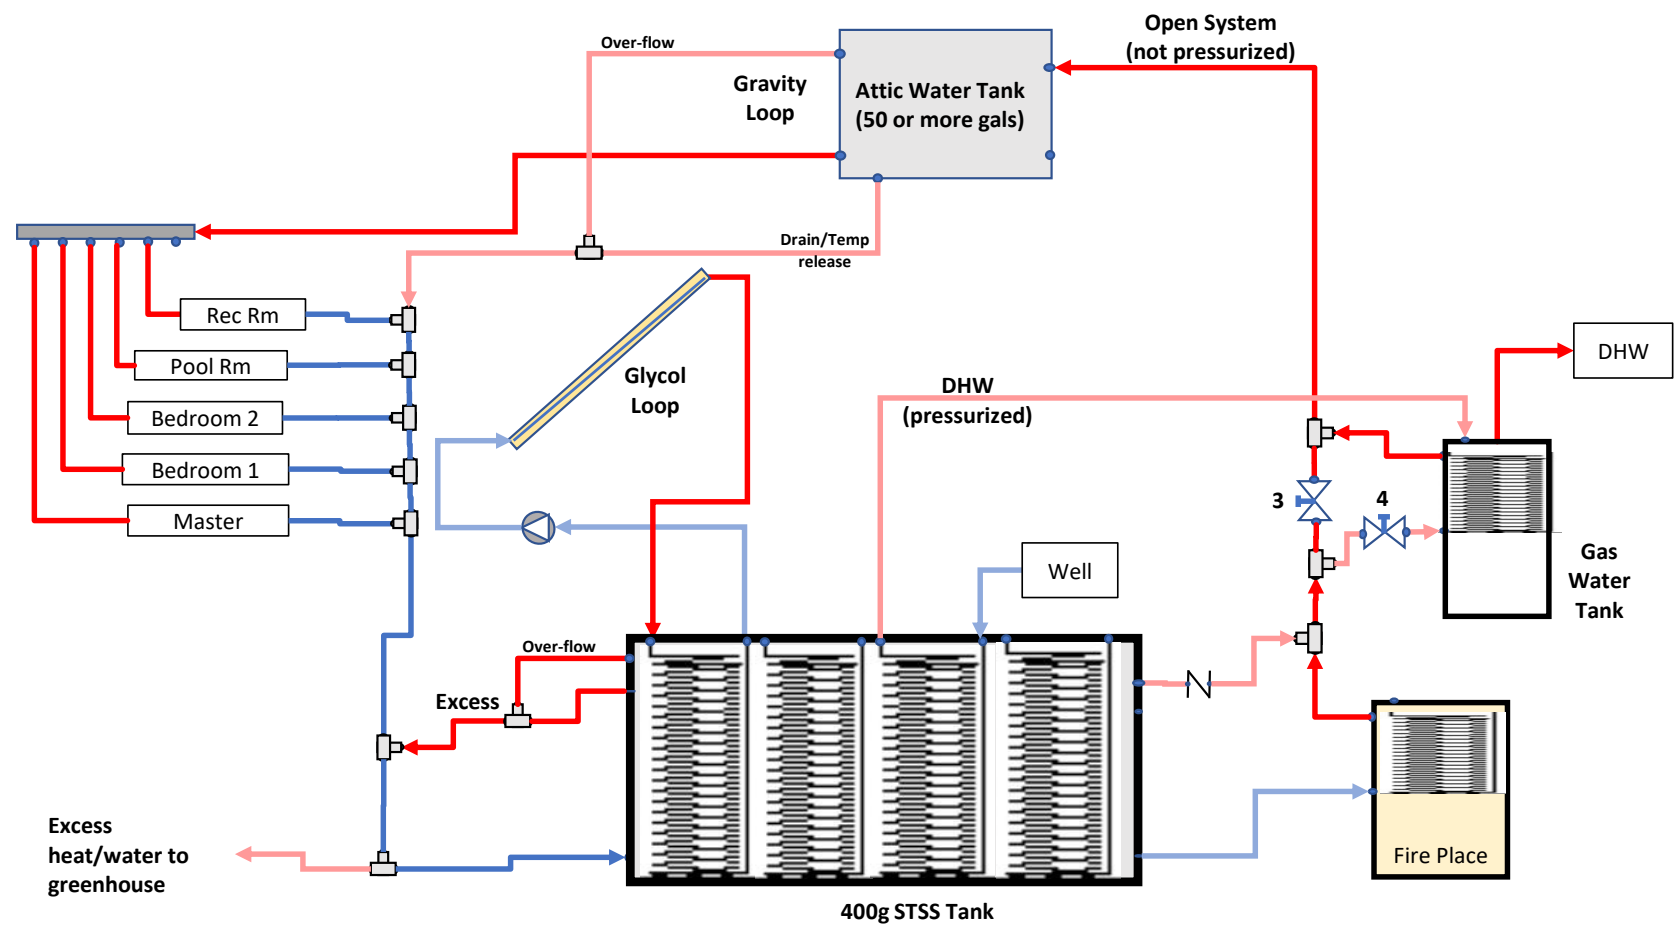

- Value
- 3 Gas Water Tank by-pass, Open when temp > 50 C
 - 4 Open when temp <= 50 C

-  Circulator Pump
-  T-Connector
-  Flow Check Value
-  Shut-Off Value